Date created, 01/26/2018 - Subject to change. © Belimo Aircontrols (USA), Inc.

B348, 3-Way, Characterized Control Valve Stainless Steel Ball and Stem








X	WARRANTY
	WARRANT

0% glycol B-port modified
B-port modified
t flow
t
0°C]
r B to AB

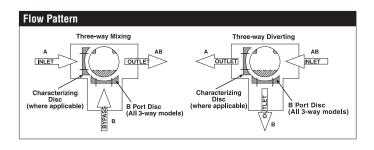


Application


This valve is typically used in air handling units on heating or cooling coils, and fan coil unit heating or cooling coils. Some other common applications include Unit Ventilators, VAV box re-heat coils and bypass loops. This valve is suitable for use in a hydronic system with variable or constant flow.


Suitable Actuators

	Non-Spring	Spring
B348	ARB(X)	AFB(X)

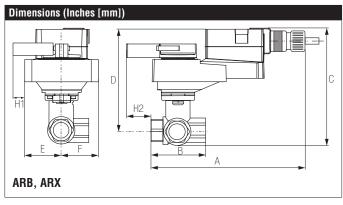


Α	В	С	D	E	F	H1
10.5"	4.90"	7.73"	5.98"	1.73" [44]	2.6" [66]	0.75" [20]
[267]	[124.5]	[196]	[152]			

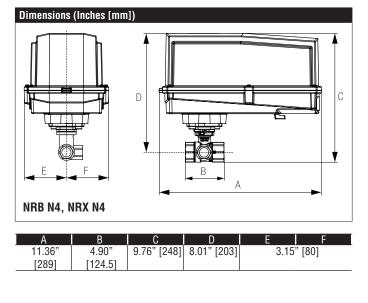

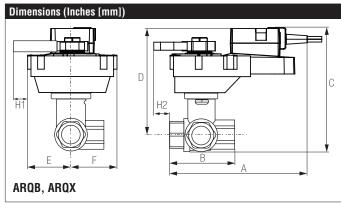

ļ ,	4	В	С	D	Е	F	H1	H2
9.	9"	4.90"	8.32"	6.57"	2.28"	2.6"	0.75"	0.5" [15]
[2	51]	[124.5]	[211]	[167]	[58]	[66]	[20]	

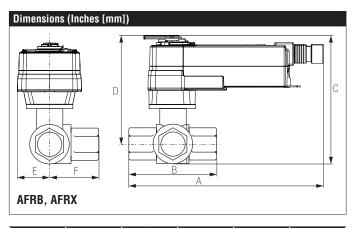

Α	В	C	D	Е	F
11.27"	4.90"	8.36" [212]	6.61" [168]	2.6"	[66]
[286]	[124.5]				

ARX24-3 On/Off, Floating Point, Non-Spring Return, 24 V





Technical Data	
Power Supply	24 VAC, ±20%, 50/60 Hz, 24 VDC, ±10%
Power Consumption Running	2.5 W
Power Consumption Holding	0.5 W
Transformer Sizing	5.5 VA (class 2 power source)
Electrical Connection	18 GA plenum rated cable with 1/2" conduit connector protected NEMA 2 (IP54) 3ft [1m] 10ft [3m] and 16ft [5m]
Overload Protection	electronic thoughout 0° to 90° rotation
Input Impedance	600 Ω
Angle of Rotation	90°
Direction of Rotation (Motor)	reversible with built-in switch
Position Indication	integrated into handle
Manual Override	external push button
Running Time (Motor)	90 sec
Ambient Temperature Range	-22°F to 122°F [-30°C to 50°C]
Storage Temperature Range	-40°F to 176°F [-40°C to 80°C]
Housing	NEMA 2, IP54
Agency Listings†	cULus acc. to UL60730-1A/-2-14, CAN/CSA E60730-1:02, CE acc. to 2004/108/EC and 2006/95/EC
Noise Level (Motor)	<45 dB (A)
Servicing	maintenance free
Quality Standard	ISO 9001

†Rated Impulse Voltage 800V, Type action 1.B , Control Pollution Degree 3.



Wiring Diagrams



X INSTALLATION NOTES



Provide overload protection and disconnect as required.



Actuators may be connected in parallel. Power consumption and input impedance must be observed.



Actuators may also be powered by 24 VDC.



Actuators Hot wire must be connected to the control board common. Only connect common to neg. (-) leg of control circuits. Terminal models (-T) have no-feedback.



Actuators with plenum cable do not have numbers; use color codes instead. Meets cULus requirements without the need of an electrical ground



connection.

WARNING! LIVE ELECTRICAL COMPONENTS!

During installation, testing, servicing and troubleshooting of this product, it may be necessary to work with live electrical components. Have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks. Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.

