

## G680LCS, 2-Way, Pressure Compensated Flanged Globe Valve




WARRANTY

chilled or hot water, up to 60% glycol,
steam
linear
stem up - open A to AB
3" [80]
125 lb. flanged
Cast Iron - ASTM A126 Class B
316 stainless steel
NLP EPDM (no lip packing)
316 stainless steel
stainless steel
ANSI 125
ANSI 125 ( up to 175 psi below 150°F)
4
150 psi (1034 kPa) @ 250°F
100 psi (690 kPa)
32°F to 350°F [0°C to 176°C]
32°F to 338°F [0°C to 170°C]
50 psi (345 kPa)
50 psi (545 kra)
50 psi (345 kPa)
91:1
90
75 lb [34 kg]
ANSI Class III
Repack/Rebuild kits available

### Application

This valve is typically used in large air handling units on heating or cooling coils. This valve is suitable for use in a hydronic system with variable flow. Bronze or stainless steel trim valves can be used for steam applications, depending on actuator and close-off combination.


Suitable Actuators				
	Non-Spring	Spring	Electronic Fail-Safe	
G680LCS	EVB(X)	AFB(X)	AVKB(X)	

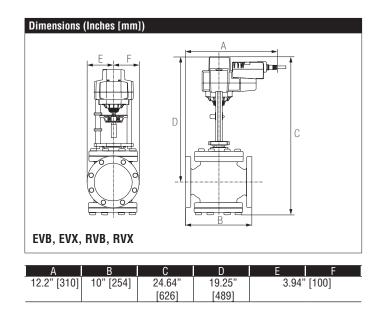

#### Piping


The valves should be mounted in a weather-protected area in a location that is within the ambient limits of the actuator. Allow sufficient room for valve with actuator and for service. The preferred mounting position of the valve is with the valve stem vertical above the valve body, for maximum life. However, the assemblies can be mounted with valve stem vertical above the valve or up to 45 degrees in relation to the horizontal pipe. The actuators should never be mounted underneath the valve, as condensation can build up and result in a failure of the actuators. Do not reverse flow direction.


## Flow Pattern

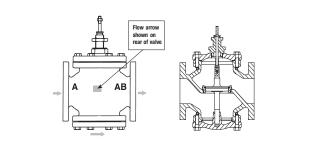



# G680LCS, 2-Way, Pressure Compensated Flanged Globe Valve

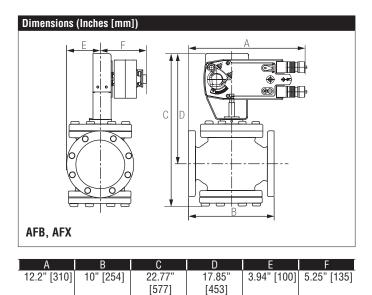

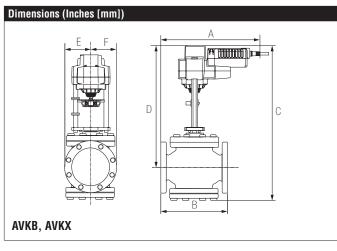

A	В	C	D	E	F
12.2" [310]	10" [254]	24.64"	19.25"	3.94"	[100]
		[626]	[489]		





Technical Data		
Power Supply	100-240 VAC ± 20%, 50/60 Hz	
Power Consumption Running	3.5 W	
Power Consumption Holding	2 W	
Transformer Sizing	6.5 VA (class 2 power source)	
Electrical Connection	3 ft, 18 GA appliance rated cable with 1/2"	
Overload Protection	conduit connector protected NEMA 2 (IP54) electronic throughout full stroke	
Electrical Protection	actuators are double insulated	
Operating Range Y	on/off, floating point	
Input Impedance	100 k Ω (0.1 mA), 500 Ω, 1000 Ω (on/off)	
Feedback Output U	No Feedback	
Stroke	1.25" [32 mm]	
Linear Force	450 lbf [2000 N force]	
Direction of Rotation (Motor)	reversible with switch	
Direction of Rotation (Fail-Safe)	reversible with switch	
Position Indication	stroke indicator on bracket	
Manual Override	5 mm hex crank (3/16" Allen), supplied	
Running Time (Motor)	90 sec, constant independent of load	
Running Time (Fail-Safe)	35 sec	
Bridge Time	2 sec delay before fail-safe activates	
Pre-charging Time	5 to 20 seconds	
Humidity	5 to 95% RH non-condensing	
Ambient Temperature Range	-22°F to 122°F [-30°C to 50°C]	
Storage Temperature Range	-40°F to 176°F [-40°C to 80°C]	
Housing	NEMA 2, IP54, UL enclosure type 2	
Housing Material	Aluminum die cast and plastic casing	
Agency Listings†	cULus acc. to UL60730-1A/-2-14, CAN/CSA	
	E60730-1:02, CE acc. to 2004/108/EC and	
	2006/95/EC	
Noise Level (Motor)	<60 dB (A)	
Noise Level (Fail-Safe)	<60 dB (A)	
Servicing	maintenance free	
Quality Standard	ISO 9001	
Weight	6.4 lb [2.9 kg]	

† Use flexible metal conduit. Push the listed conduit fitting device over the actuator's cable to butt against the enclosure. Screw in conduit connector. Jacket the actuators input wiring with listed flexible conduit. Properly terminate the conduit in a suitable junction box. Rated impulse Voltage 800V. Type of action 1. Control pollution degree 3.



AVKB120-3 On/Off, Floating Point, Electronic Fail-Safe, Linear, 120 V

#### Wiring Diagrams

 $/_2$ 

### 🔀 INSTALLATION NOTES

A Actuators with appliance cables are numbered.

Actuators may be connected in parallel. Power consumption and input impedance must be observed.

Meets cULus requirements without the need of an electrical ground connection.

### WARNING! LIVE ELECTRICAL COMPONENTS!

During installation, testing, servicing and troubleshooting of this product, it may be necessary to work with live electrical components. Have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks. Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.

