

**MK-3000 Series, MK2-3000 Series, MK4-3000 Series
 Pneumatic Damper Actuators
 General Instructions**

APPLICATION

Proportional pneumatic actuator with 8 in.² (52 cm²) effective area used to control dampers, mixing boxes, air valves, etc., in heating, ventilating and air conditioning systems. MK2-31X1 used for high temperatures.

SPECIFICATIONS

Construction:

- Housing,** Die cast aluminum.
- Diaphragm,** Beaded molded neoprene.
MK2-31X1 only — Beaded molded silicone.

Stroke: See Table 2.

Start Point: Adjustable on most models ±1 psi, see Table 2.

Spring: Retracts actuator shaft on loss of air pressure.

Maximum Air Pressure: 30 psig (207 kPa).

Ambient Temperature Limits:

- Shipping,** -40 to 160°F (-40 to 71°C).
- Operating,** -20 to 160°F (-29 to 71°C).
MK2-31X1 only —
- Shipping,** -40 to 250°F (-40 to 121°C).
- Operating,** -20 to 250°F (-29 to 121°C), for 30 minute exposure 450°F (232°C).

Air Connections: 1/8" FNPT.

Mounting: In any position. Mounting bracket (except MK-3300 Series end mounting) and connector for 5/16" (8 mm) diameter push rod included with actuator.


Dimensions: 12" high x 5-7/8" wide x 5-1/2" deep (305 mm x 143 mm x 140 mm)

OPTIONS None


ACCESSORIES

- AK-42309-500 Positive positioner and linkage, do not use with MK2-3100 series
- AM-111 Crank arm for 5/16" diameter damper shaft
- AM-112 Crank arm for 3/8" diameter damper shaft
- AM-113 Crank arm for 1/2" diameter damper shaft
- AM-115 Crank arm for 7/16" diameter damper shaft
- AM-122 Linkage connector straight type
- AM-123 Damper clip
- AM-125 5/16" x 20" damper rod
- AM-125-048 5/16" x 48" damper rod
- AM-132 Ball joint connector
- AM-161-3 Damper linkage kit
- AM-301 90° mounting bracket for pivot mounting
- AM-530 Crank arm for 1/2" diameter damper shaft holes for 3-1/2" and 4-1/2" stroke
- AM-532 Bolt-on frame lug and damper blade clip kit
- AM-533 Actuator shaft extension
- AM-534 Pivot stud for pivot mounting
- AM-535 Clevis for pivot mounting
- AM-536 Mounting plates for pivot mounting on ducts or damper frame
- AM-545 Rod end connector for 5/16" (10 mm) dia. rods
- TOOL-95 Pneumatic calibration tool kit


**MK-3100 Series
 MK2-3100 Series**

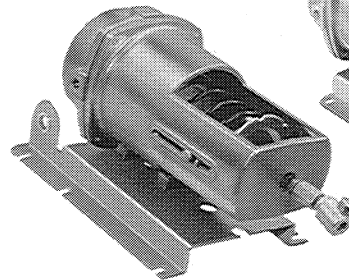

MK-3200 Series

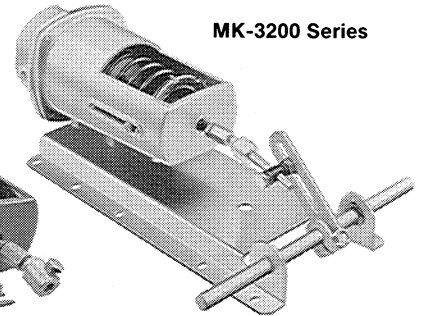

**MK-3101-108 and
 MK-3300 Series
 (MK-3311-109 Shown)**

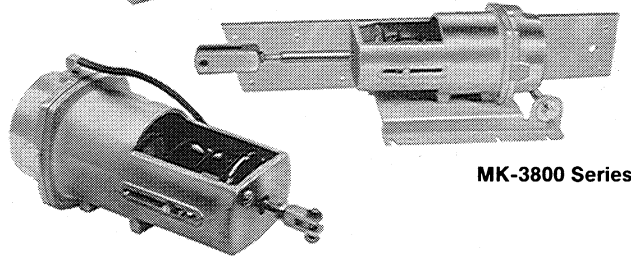

MK-3800 Series

TABLE 1. NOMINAL DAMPER AREA FOR PROPORTIONAL CONTROL†

Actuator Part Number	Parallel Blades		Opposed Blades	
	ft ²	m ²	ft ²	m ²
MK-3101	11.6	1.07	15	1.39
MK-3101-108				
MK2-3101				
MK4-3101				
MK-3111				
MK2-3111				
MK-3121-109				
MK-3121				
MK2-3121				
MK-3141				
MK4-3141				
MK-3151				
MK-3161*				
MK-3201				
MK-3211				
MK-3221				
MK-3311-109				
MK-3321-102				
MK-3801				
MK4-3801				
MK-3811				
MK-3821				
MK-3841				
MK4-3841				
MK4-3111**	23.2	2.15	30	2.79
MK4-3811**				
MK4-3121***	34.8	3.23	45	4.18
MK4-3821***				

*Requires 20 psi be available to the actuator.
 **Requires minimum 15 psi be available to the actuator.
 ***Proportional control with positioner (8-13 spring, 20 psi supply).
 †For two-position control use proportional rating of the same actuator with positive positioner. Damper ratings are nominal and based on standard (not low leakage) dampers at 1" (25.4 mm) W.C. static pressure and 2000 fpm (10 m/s) velocity.

TABLE 2. SPECIFICATIONS

Part Number	Nominal Operating Range		Starting Pressure		Nominal Stroke †††	Maximum Force††								Nominal Torque** Proportional Control†††						
						Return Stroke		Power Stroke						15 psi (103 kPa) Supply Dual Press. System		15 psi (103 kPa) Supply Single Press. System†		20 psi (138 kPa) Supply Single or Dual Press. System†		
						Based on 1.5 psi (10 kPa) Pressure to Actuator		15 psi (103 kPa) Supply Dual Press. System	15 psi (103 kPa) Supply Single Press. System†	20 psi (138 kPa) Supply Single or Dual Press. System†					15 psi (103 kPa) Supply Dual Press. System	15 psi (103 kPa) Supply Single Press. System†	20 psi (138 kPa) Supply Single or Dual Press. System†			
psig	kPa	psig	kPa	in. (mm)	lb.	N	lb.	N	lb.	N	lb.	N	lb-in.	N-m	lb-in.	N-m	lb-in.	N-m		
MK-3101-108	3-7.2	21-50	3 ±1	21 ±7	3 (76), Adjustable 2 to 4 (51 to 102)	12	53	50	223	62	276	102	454	18	2.03	18	2.03	18	2.03	
MK-3101 MK2-3101	3-8	21-55	3 ±1	21 ±7	3½ (89), Adjustable 2 to 4 (51 to 102)	12	53	44	196	56	249	96	427	21	2.37	21	2.37	21	2.37	
MK4-3101*	3-8	21-55	3 ±1	21 ±7		12	53	44	196	56	249	96	427	21	2.37	21	2.37	21	2.37	
MK-3111 MK2-3111	5-10	34-69	5 ±1	34 ±7		28	125	28	125	40	178	80	356	21	2.37	21	2.37	21	2.37	
MK4-3111*	5-10	34-69	5 ±1	34 ±7		28	125	28	125	40	178	80	356	49	5.54	49	5.54	49	5.54	
MK-3121 MK2-3121-109 MK2-3121	8-13	55-90	8 ±1	55 ±7		52	231	4	18	16	71	56	249	7	.79	21	2.37	21	2.37	
MK4-3121*	8-13	55-90	8 ±1	55 ±7		52	231	4	18	16	71	56	249	7	.79	28	3.16	91	10.28	
MK-3141 MK4-3141*	3-13	21-90	3 non-adj.	21 non-adj.		12	53	4	18	16	71	56	249	7	.79	21	2.37	21	2.37	
MK-3151	3-6, 9-12	21-41, 62-83	3-6	21 to 41		2¼ (70), Adjustable 2 to 2¾ (51 to 70)	12	53	12	53	24	107	64	285	21	2.37	21	2.37	21	2.37
MK-3161	3-6, 11-17	21-41, 76-117	3-6	21 to 41		12	53	0	0	0	0	24	107	0	0	0	0	21	2.37	
MK-3201	3-8	21-55	3 ±1	21 ±7		90° Rotation Typical, Adjustable 1.2 to 4.4 (30 to 111)	12	53	44	196	56	249	96	427	21	2.37	21	2.37	21	2.37
MK-3211	5-10	34-69	5 ±1	34 ±7	28		125	28	125	40	178	80	356	21	2.37	21	2.37	21	2.37	
MK-3221	8-13	55-90	8 ±1	55 ±7	52		231	4	18	16	71	56	249	7	.79	21	2.37	21	2.37	
MK-3311-109	5-10	34-69	5 ±1	34 ±7	3½ (89), Adjustable 2 to 4 (51 to 102)	28	125	28	125	40	178	80	356	21	2.37	21	2.37	21	2.37	
MK-3321-102	8-13	55-90	8 ±1	55 ±7		52	231	4	18	16	71	56	249	7	.79	21	2.37	21	2.37	
MK-3801 MK4-3801*	3-8	21-55	3 ±1	21 ±7	3½ (89), Adjustable 2 to 4 (51 to 102)	12	53	44	196	56	249	96	427	21	2.37	21	2.37	21	2.37	
MK-3811	5-10	34-69	5 ±1	34 ±1		28	125	28	125	40	178	80	356	21	2.37	21	2.37	21	2.37	
MK4-3811*	5-10	34-69	5 ±1	34 ±1		28	125	28	125	40	178	80	356	49	5.54	49	5.54	49	5.54	
MK-3821	8-3	55-90	8 ±1	55 ±1		52	231	4	18	16	71	56	249	7	.79	21	2.37	21	2.37	
MK4-3821*	8-13	55-90	8 ±1	55 ±1		52	231	4	18	16	71	56	249	7	.79	28	3.16	91	10.28	
MK-3841 MK4-3841*	3-13	21-90	3 non-adj.	21 non-adj.		12	53	4	18	16	71	56	249	7	.79	21	2.37	21	2.37	

*Factory installed positive positioner (AK-42309-500) start point adjustable 2 to 10 psi with range adjustable 2 to 10 psi.

**Nominal torque for actuators without positive positioner is based on 1.5 psi pressure change at the actuator.

†Adjust pressure reducing valve so that listed pressures are available at the actuator.

††Force and torques based on factory set stroke and starting pressure.

†††Factory setting required for published operating range.

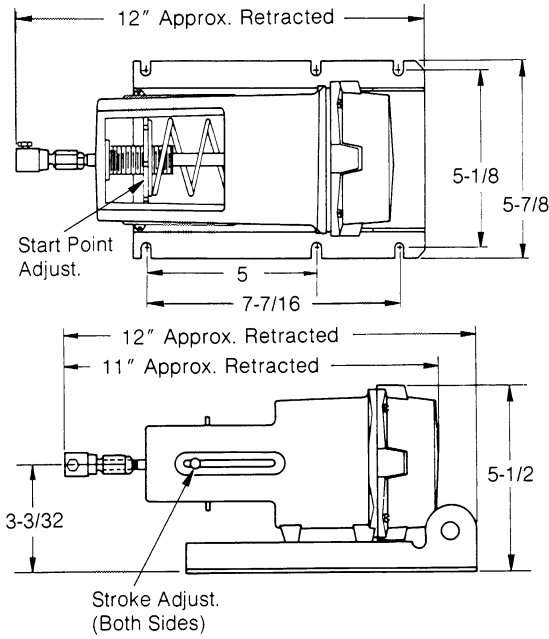


Figure 1. MK-3100 Series Dimensions


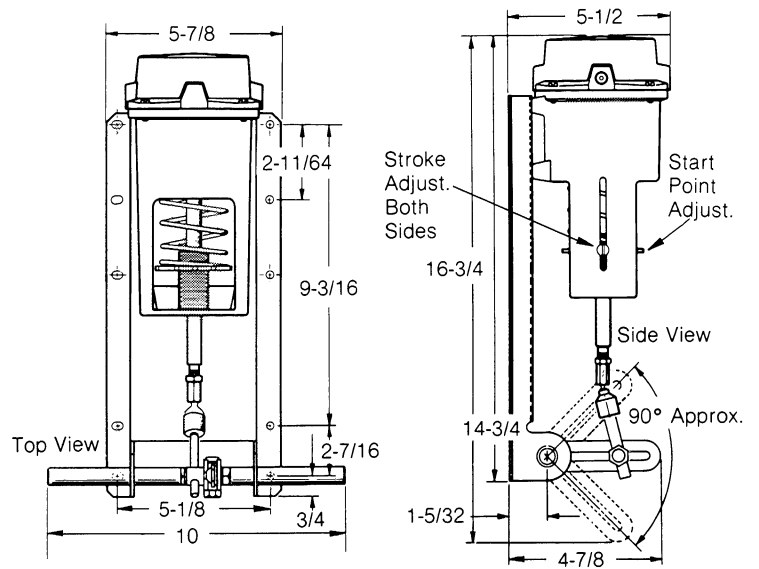


Figure 2. MK-3200 Series Dimensions

All Dimensions shown in this Instruction Sheet are in Inches

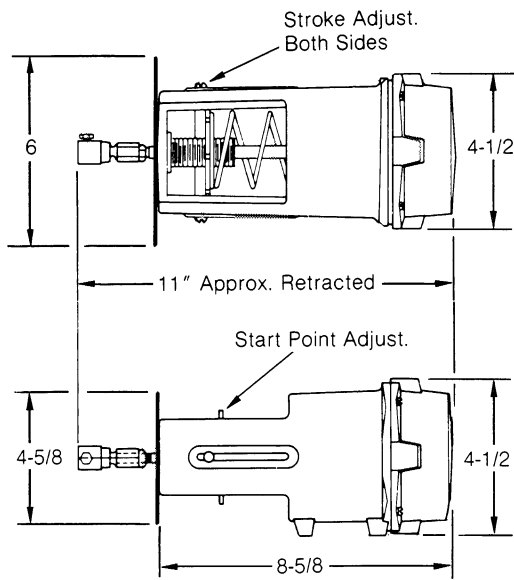

Mounting Plate for MK-3101-108 & MK-3300-102 Series Actuator

Figure 3. MK-3300 Series Dimensions*

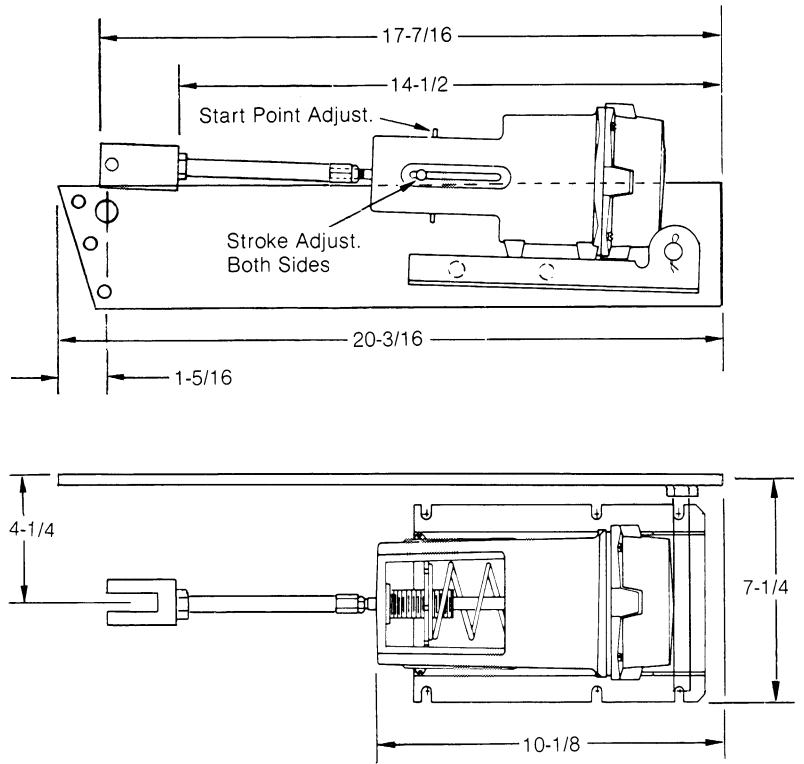


Figure 4. MK-3800 Series Dimensions

* Typical Model shown. Mounting, Linkage, and air connection details may vary from Model to Model.

MK-3100 Series Typical Mounting

Accessories Required for Mounting per Figure 5

- 1 — AM-113 crank arm.
- 1 — AM-122-0-0-2 or AM-132-0-0-2 ball joint.
- 1 — AM-125 link rod 5/16-inch x 20 inches.

To mount proceed as follows. Refer to Figure 5.

1. Measure a minimum of 8 inches from damper shaft in the direction of actuator location.
2. Hold actuator up to duct with actuator shaft approximately 1-1/2 inches above (N.C.) or below (N.O.) damper shaft and mark mounting holes.
3. With drill or punch, pierce holes marked in Step 2.
4. Mount actuator to duct.
5. Attach ball joint to crank arm at approximately 2-1/2 inches from center of shaft hole.
6. Attach crank arm to damper shaft at approximately 45° angle, from vertical, toward actuator with damper in the normal actuator retracted position.
7. Connect actuator ball joint to crank arm ball joint with 5/16-inch diameter rod. Cut off excess rod.
8. Refer to Checkout.

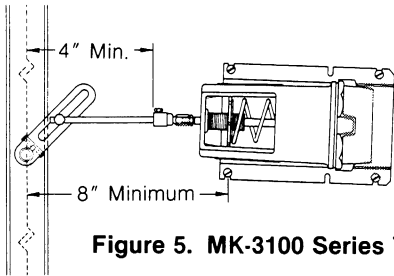


Figure 5. MK-3100 Series Typical Mounting

MK-3300 Series Typical Mounting

NOTE

MK-3300 Series Models are designed for Mixing Box applications. Mounting, Linkage, and air connection details vary among Models. See Actuator Selection Sheet F-13795 for more information.

Accessories Required for Mounting per Figure 8

- 1 — AM-125 link rod 5/16-inch x 20 inches.
- 1 — Connector as required for connection to driven device.

To mount proceed as follows. Refer to Figures 6 and 8.

1. Drill holes in mounting surface as shown in Figure 6.
2. Mount actuator.
3. Connect actuator.
4. Refer to Checkout.

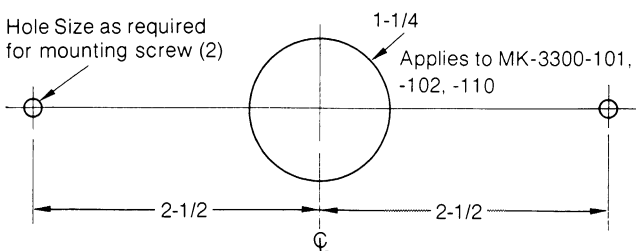


Figure 6.

MK-3200 Series Typical Mounting

Accessories Required for Mounting per Figure 7

- 2 — AM-113 crank arm.
- 2 — AM-122-0-0-2 or AM-132-0-0-2 ball joint.
- 1 — AM-125 link rod 5/16-inch x 20 inches.

To mount proceed as follows. Refer to Figure 7.

1. Locate actuator on a surface perpendicular to the damper shaft, with the actuator rotary shaft approximately in line with the damper shaft.
2. Hold actuator up to duct and mark mounting holes.
3. With drill or punch, pierce holes marked in Step 2.
4. Mount actuator to duct.
5. Attach crank arm to actuator shaft at approximately 45° angle.
6. Attach ball joint to crank arm at approximately 2-1/2 inches from center of shaft hole.
7. Attach crank arm to damper shaft at approximately 45° angle, from vertical, toward actuator with damper in the normal actuator retracted position.
8. Attach ball joint to crank arm at approximately 2-1/2 inches from center of shaft.
9. Connect actuator ball joint to crank arm ball joint with 5-1/6-inch diameter rod. Cut off excess rod.
10. Refer to Checkout.


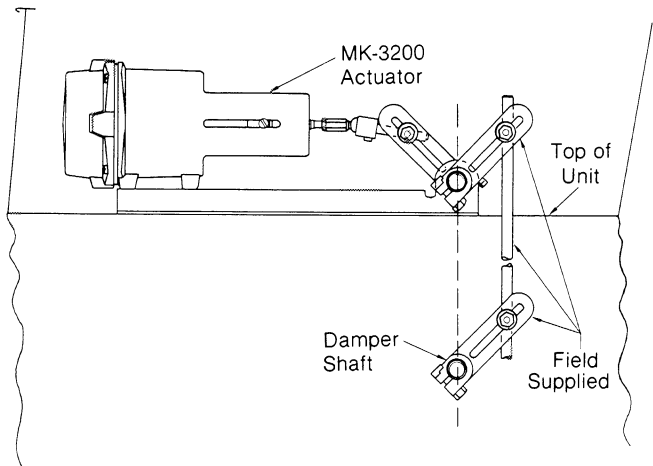


Figure 7. MK-3200 Series Typical Mounting

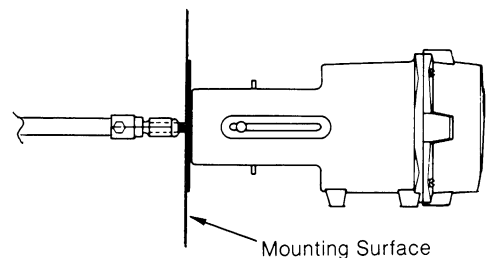

MK-3300-101 shown

Figure 8. MK-3300 Typical Mounting

MK-3800 Series Typical Mounting

Accessories Required for Mounting of Actuator per Figure 9 through 11

1 — AM-532 bolt-on frame bracket kit.

NOTE

Bracket kit includes the frame bracket, leaf connector, and necessary screws or bolts and nuts.

To install the actuator proceed as follows:

1. Prepare the damper by drilling necessary holes, etc. See Figures 11 and 15 for bolt-on bracket.
2. Attach bracket and leaf connector to damper.
3. Attach actuator mounting plate to damper bracket.
4. Install pivot stud to actuator mounting plate.
5. Install actuator to pivot stud and connect clevis to blade connector.

NOTE

Adjust clevis as needed to align clevis and leaf connector.

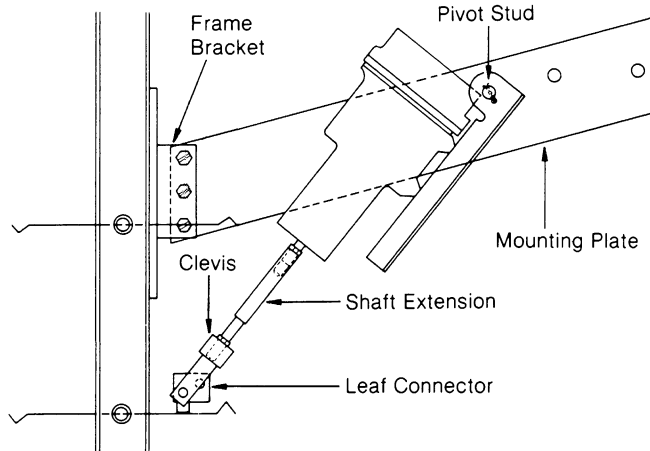


Figure 9.

MK-3800 Series Typical Mounting, Normally Open

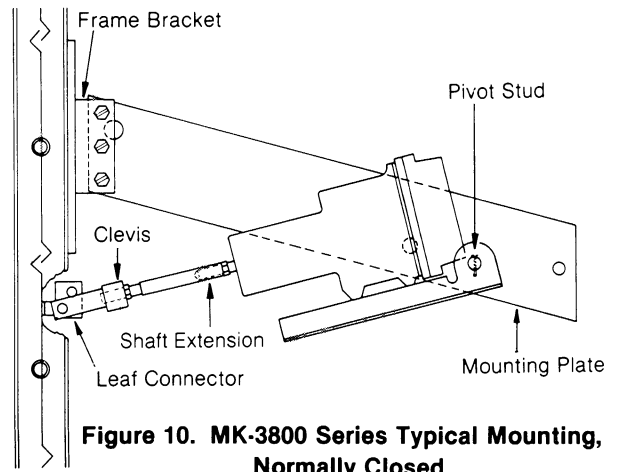


Figure 10. MK-3800 Series Typical Mounting, Normally Closed

Preparing Damper for Frame Mounting of Actuator

Refer to Figures 11 and 15 for required holes, etc. for AM-532.

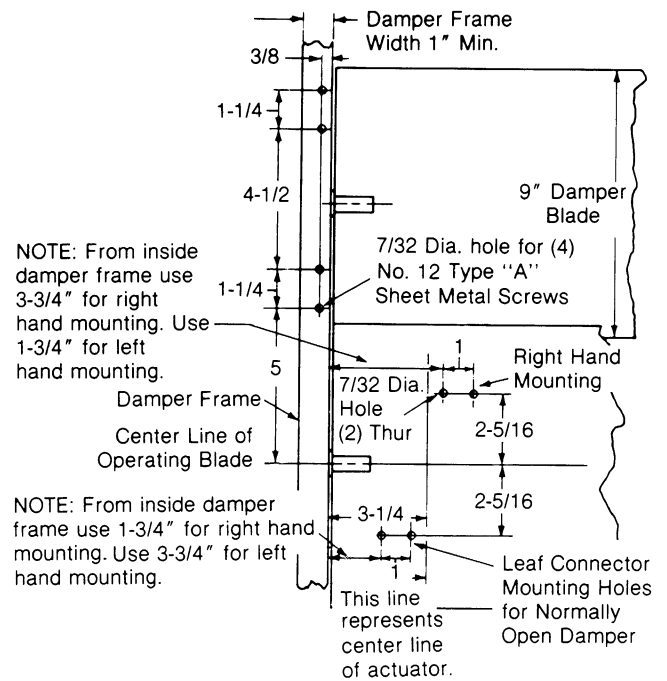


Figure 11. Typical Bolt-on Bracket Mounting

Accessories Required for Mounting of Actuator per Figure 12

1 — AM-530 crank arm.

To install proceed as follows:

1. Attach mounting plate to duct or wall with damper shaft protruding through locator hole in mounting plate. If this is not possible, additional shaft extensions may be used to allow locating the actuator farther from the damper shaft. Each extension provides 4 inches of extension to the actuator shaft and may be used in multiples.
2. Install the pivot stud to the mounting plate.
3. Install actuator on pivot stud.
4. Install crank arm on damper shaft at approximately 45° angle from vertical toward actuator.

NOTE

Figure 12 shows position for normally closed.

5. Manually position damper to full retracted actuator position and tighten crank arm in position described in Step 4.
6. Connect clevis to crank arm in hole closest to damper shaft. If necessary adjust clevis and/or extensions.
7. Refer to check out.

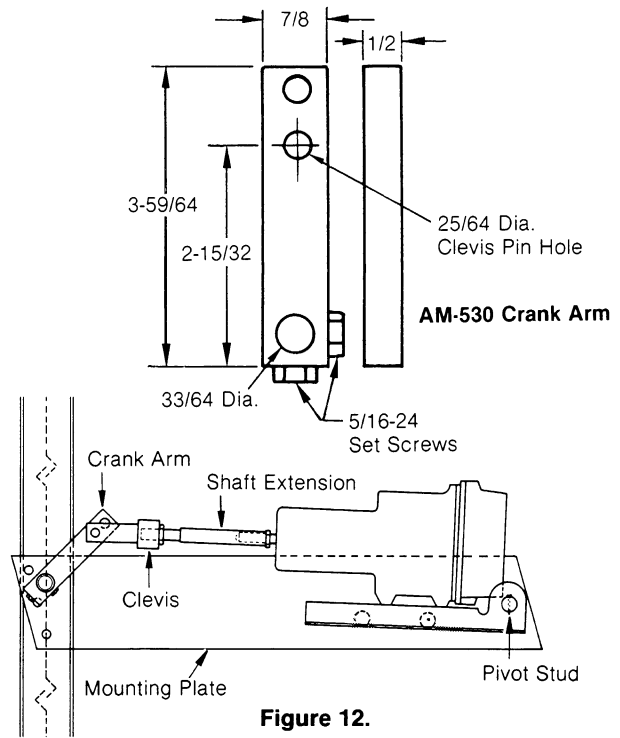


Figure 12.
MK-3800 Typical External Pivot Mounted

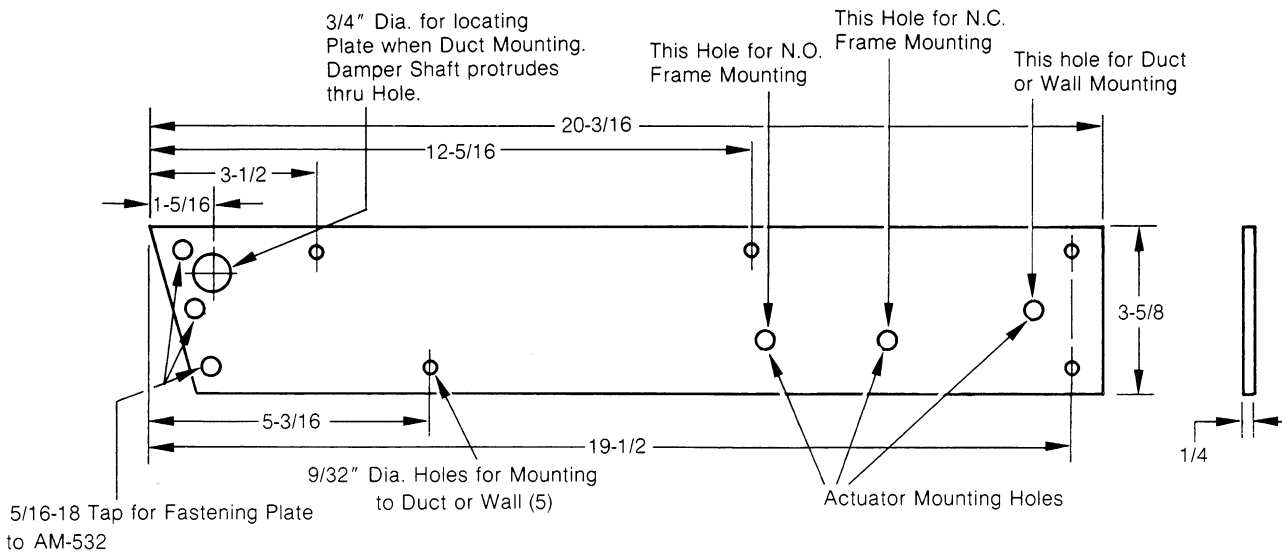


Figure 13. MK-3800 Series Mounting Plate

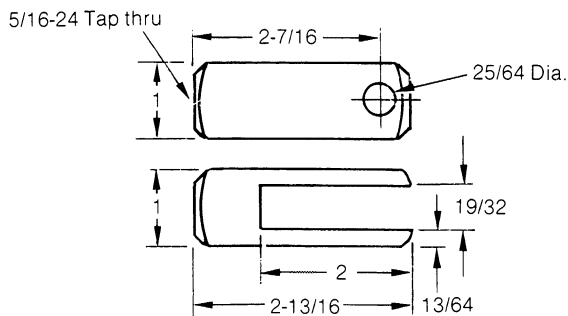


Figure 14. MK-3800 Series Clevis

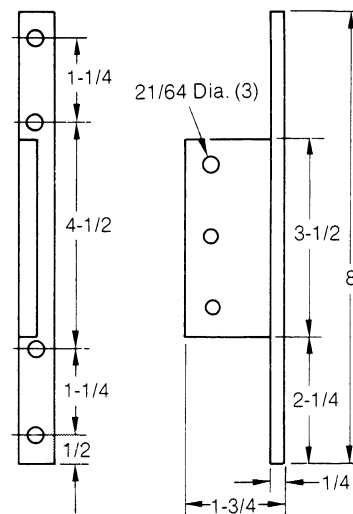


Figure 15. AM-532 Bolt-on Frame Bracket

CHECKOUT

After installation, the actuator should be checked to insure proper damper operation. To check the actuator and linkage, proceed as follows:

1. Check the linkage with the actuator in the retracted position for proper return force. The actuator should be linked so that on a normally closed application, the damper is closed with no more than 1/16-inch compression of the spring. (The actuator shaft would return an additional 1/16-inch if the linkage were disconnected.) For a normally open application, the actuator should be linked with the actuator fully retracted.
2. Apply air pressure to the actuator or pilot port of a positioner and check the linkage as follows. On a normally closed application, the damper should be just full open when the actuator piston reaches the stops in the actuator. On a normally open application, the damper should reach the closed position with no more than 1/16-inch stroke remaining to reach the actuator stops.
3. The above can be obtained through adjustment of the ball joint in the crank arms or by adjustment of the actuator stops. The amount of thread engagement of the actuator ball joint or extension shaft may also be used to assist in proper linking.

Connection of Air Line: On pivot mounting arrangements, Figures 9, 10 and 12, control air lines MUST be terminated at the actuator with at least 6 inches of flexible tubing to allow for pivoting of the actuator. On mounting arrangements, Figures 5, 7 and 8, control air lines may be connected directly with either copper or plastic tubing, as required by application.

CAUTION

On MK2-31X1 Series, metal connectors and tubing must be used.

Adjustable Starting Pressure: Actuators are available with adjustable starting pressure. To adjust the starting pressure, turn adjusting nut supporting the spring clockwise to increase, and counterclockwise to decrease the starting pressure. Each rotation of the adjusting nut changes the starting pressure .04 psi (.28 kPa).

Adjustable Stroke Length: Stroke length is determined by the two stops located on either side of the actuator. Stops are set for 3-1/2-inch stroke. Mark this point and measure toward the diaphragm end of the actuator to reduce the stroke or away from the diaphragm end to increase the stroke. Maximum stroke length is 4 inches. By increasing the stroke length, the force available to resist an opposing force is decreased while decreasing the stroke length increases this force.

Diaphragm Replacement: If the actuator diaphragm should leak, it may easily be replaced by removing the four screws holding the top power housing. Make sure the shaft swivel joint is in place on the end of the shaft. Remove the screws and old diaphragm. Roll the new diaphragm inside out and install over the piston making sure the circular bead is facing up. Put the top power housing back in place making sure the bead on the diaphragm is in the housing groove and the screw holes are lined up. Tighten housing screws.

UNITS WITH FACTORY MOUNTED POSITIVE POSITIONERS

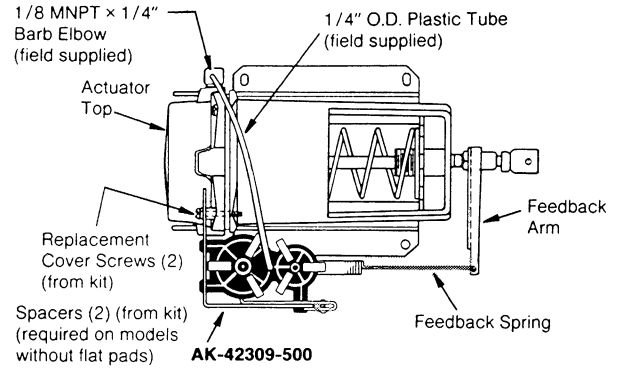


Figure 16. Typical Factory Mounted Positioner

For Actuators with Positioners:

NOTE

If actuator is frame pivot mounted, the actuator must be mounted to the left-hand frame. If actuator is mounted external, Figure 12 must be on right-hand side of duct.

Install fittings required in Ports 2 and 3.

ADJUSTMENTS Refer to Figure 16.

Range Adjustment: Adjustable 2 to 10 psig (14 to 69 kPa). Factory set at 5 psig (34 kPa). Range is the pressure change required to produce full actuator stroke.


If adjustment is required (see Figure 16), with a small screwdriver loosen screw on range slider approximately 1/2 turn.

Move the graduated range slider until desired pressure mark lines up with center of screw and tighten screw.

Start Point: Adjustable 2 to 10 psig (14 to 69 kPa). Start point is the pressure at which the actuator just begins to extend. See Figure 16.

Connect main air supply to Port 3 and a variable air supply to Port 2.

1. Adjust variable air supply on Port 2 to desired start point pressure.
2. Adjust the start point screw with small screwdriver until actuator just starts to extend.
3. Gradually raise pressure on Port 2 until actuator is fully extended, and readjust range slider to obtain desired range if further adjustment is necessary.
4. Remove variable air supply from Port 2 and connect to controller output.



NOTE: If slave damper actuators are to be controlled, tee into the tubing from Port 1 to the actuators. All dampers must be mechanically interconnected.

Figure 17. Typical Piping Diagram with Factory Mounted Positive Positioner

